



DRAFT DRAWING (NOT DEFINITIVE)

(EN 81-20/50)


MAIN FEATURES	
Nominal load:	450 kg 6 Passengers
Speed:	1 m/s
Travel:	3 m
N. of stops:	2
Nº of acceses:	2
Lighting power:	230 V
Grid voltage:	400 V
N. of phases:	3 PHASES+NEUTRAL
Frequency:	50 Hz
Machine power:	3,4 kW
Heat rejected:	0,3 kW
Power grid supply:	4 kW
Nom. Current grid:	6,85 A
Max. Current grid:	8,1 A
Short circuit rating:	6 KA
Controller type:	COLEC-SELEC SIMPLEX
Deadweight car+frame:	494 kg
Number of ropes:	4
%Counterweighed:	45 %

LOADS IN DaN	
P1: 2790 daN	P8: - daN
P2: 3780 daN	P9: - daN
P3: 385 daN	P10: - daN
P4: 1600 daN	P11: daN
P5: - daN	P12: daN
P6: - daN	P13: daN
P7: - daN	P14: daN

RANGING MEASURES MRL	
A: 386 mm	F: 1414 mm
B: 111 mm	G: mm
C: 1414 mm	H: mm
D: 111 mm	I: mm
E: 201 mm	

CUSTOMER ----			
ADDRESS Honlaphoz adat			
CITY Magyarország			REF. 857699
	DRAWN 20/05/2019 EXNYI00004	SCALE	
	CHECKED	UNIT mm	PAGE 1/9

DRAFT DRAWING (NOT DEFINITIVE)

	CAR GUIDE	COUNTERWEIGHT GUIDE	
Guide type	T-125 L1/A	T-50/A	
Clip type	M2	SL1	
Max distance between brackets [mm]	3200	3500	
Fx max [daN]	232,36	5,9	
Fy max [daN]	91,62	13,47	
Fv max [daN]	1000,27	24,52	
s perm [N/mm ²]	261,11	125,33	
s max [N/mm ²]	175,65	54,3	
d perm [mm]	5	10	
d guide max X [mm]	5	3,41	
d guide max Y [mm]	3,76	3,64	
d str max [mm]	0	0	

* Information about guides and flanges available on Orona's web 'Documentation per OV'

LANDING DOOR FIRE REGULATION

	ENTRANCE 1
E120	0,1

REMARKS

- All the conditions in the document 'Work preparation guide' must be followed
- Optimum assembly process: Orona Platform

CUSTOMER ----
 ADDRESS Honlaphoz adat
 CITY Magyarország



DRAWN 20/05/2019
EXNYI00004

SCALE

DRAWING N°

CHECKED

UNIT mm

PAGE 2/9


REF.

857699

DRAFT DRAWING (NOT DEFINITIVE)

1

0

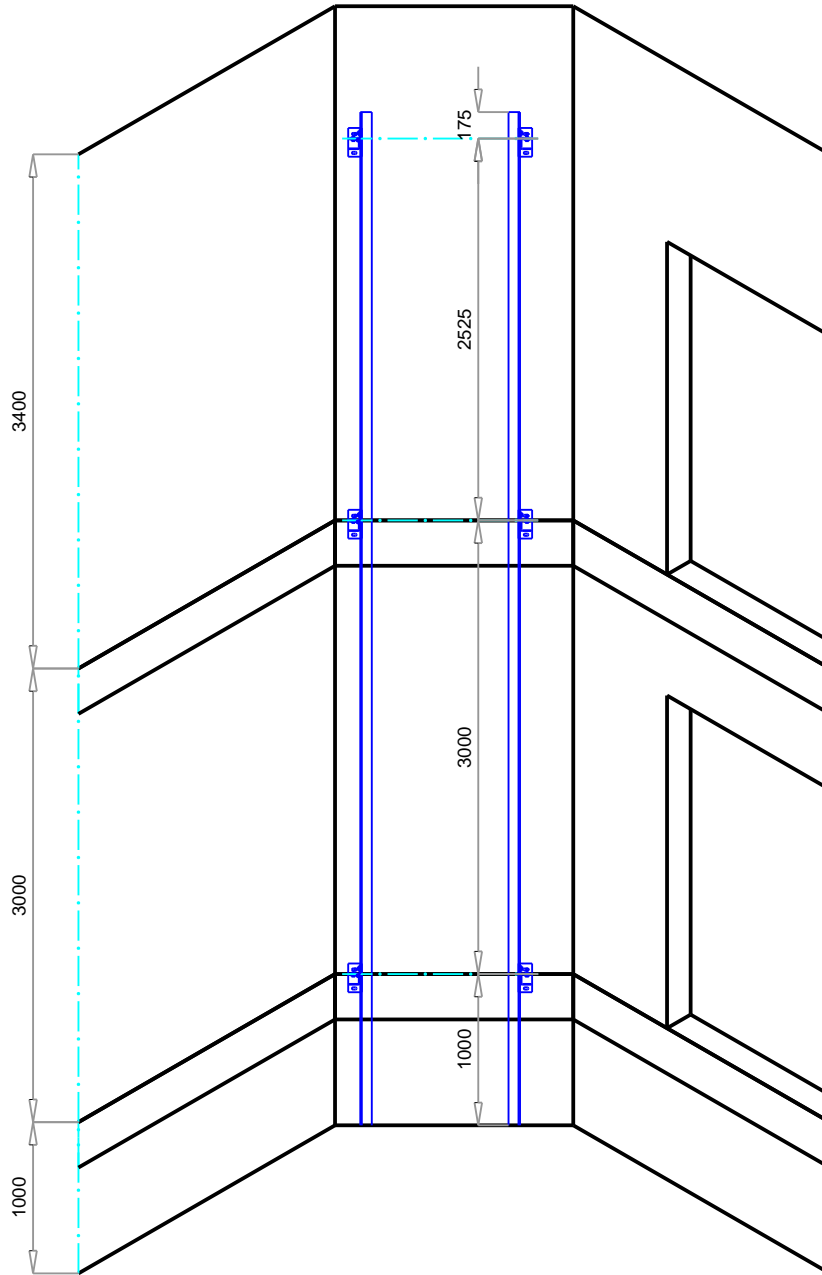

TRAVEL HEIGHT = 3000 mm
 NUMBER OF BRACKETS = 3
 DISTANCE BETWEEN 1ST AND 2ND BRACKET >= 2360 mm TO PLACE THE PIT LADDER
 MAX DISTANCE BETWEEN BRACKETS = 3200 mm

CUSTOMER ----
 ADDRESS Honlaphoz adat
 CITY Magyarország




DRAWN	20/05/2019 EXNYI00004	SCALE	DRAWING N°
CHECKED		UNIT mm	PAGE 3/9


REF. 857699

DRAFT DRAWING (NOT DEFINITIVE)


According to EN-81-20
Point E.3.2, and local
building regulation

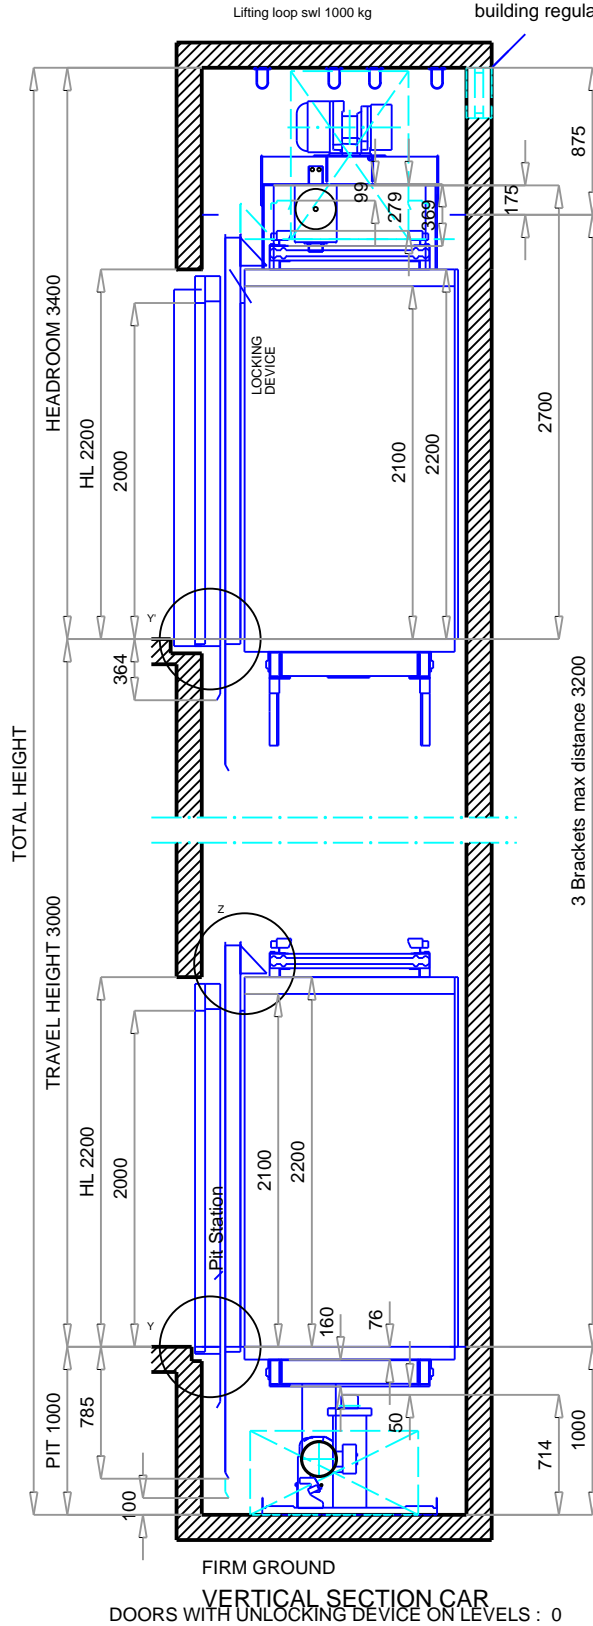

Y' DETAIL

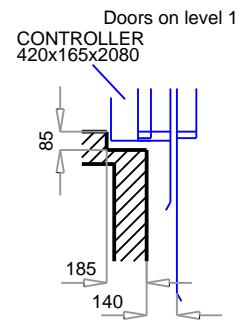

Y DETAIL



CUSTOMER ----
ADDRESS Honlaphoz adat
CITY Magyarország



DRAWN 20/05/2019
EXNY100004

SCALE

DRAWING N°

CHECKED


UNIT mm

PAGE 4/9

REF.

857699

DRAFT DRAWING (NOT DEFINITIVE)

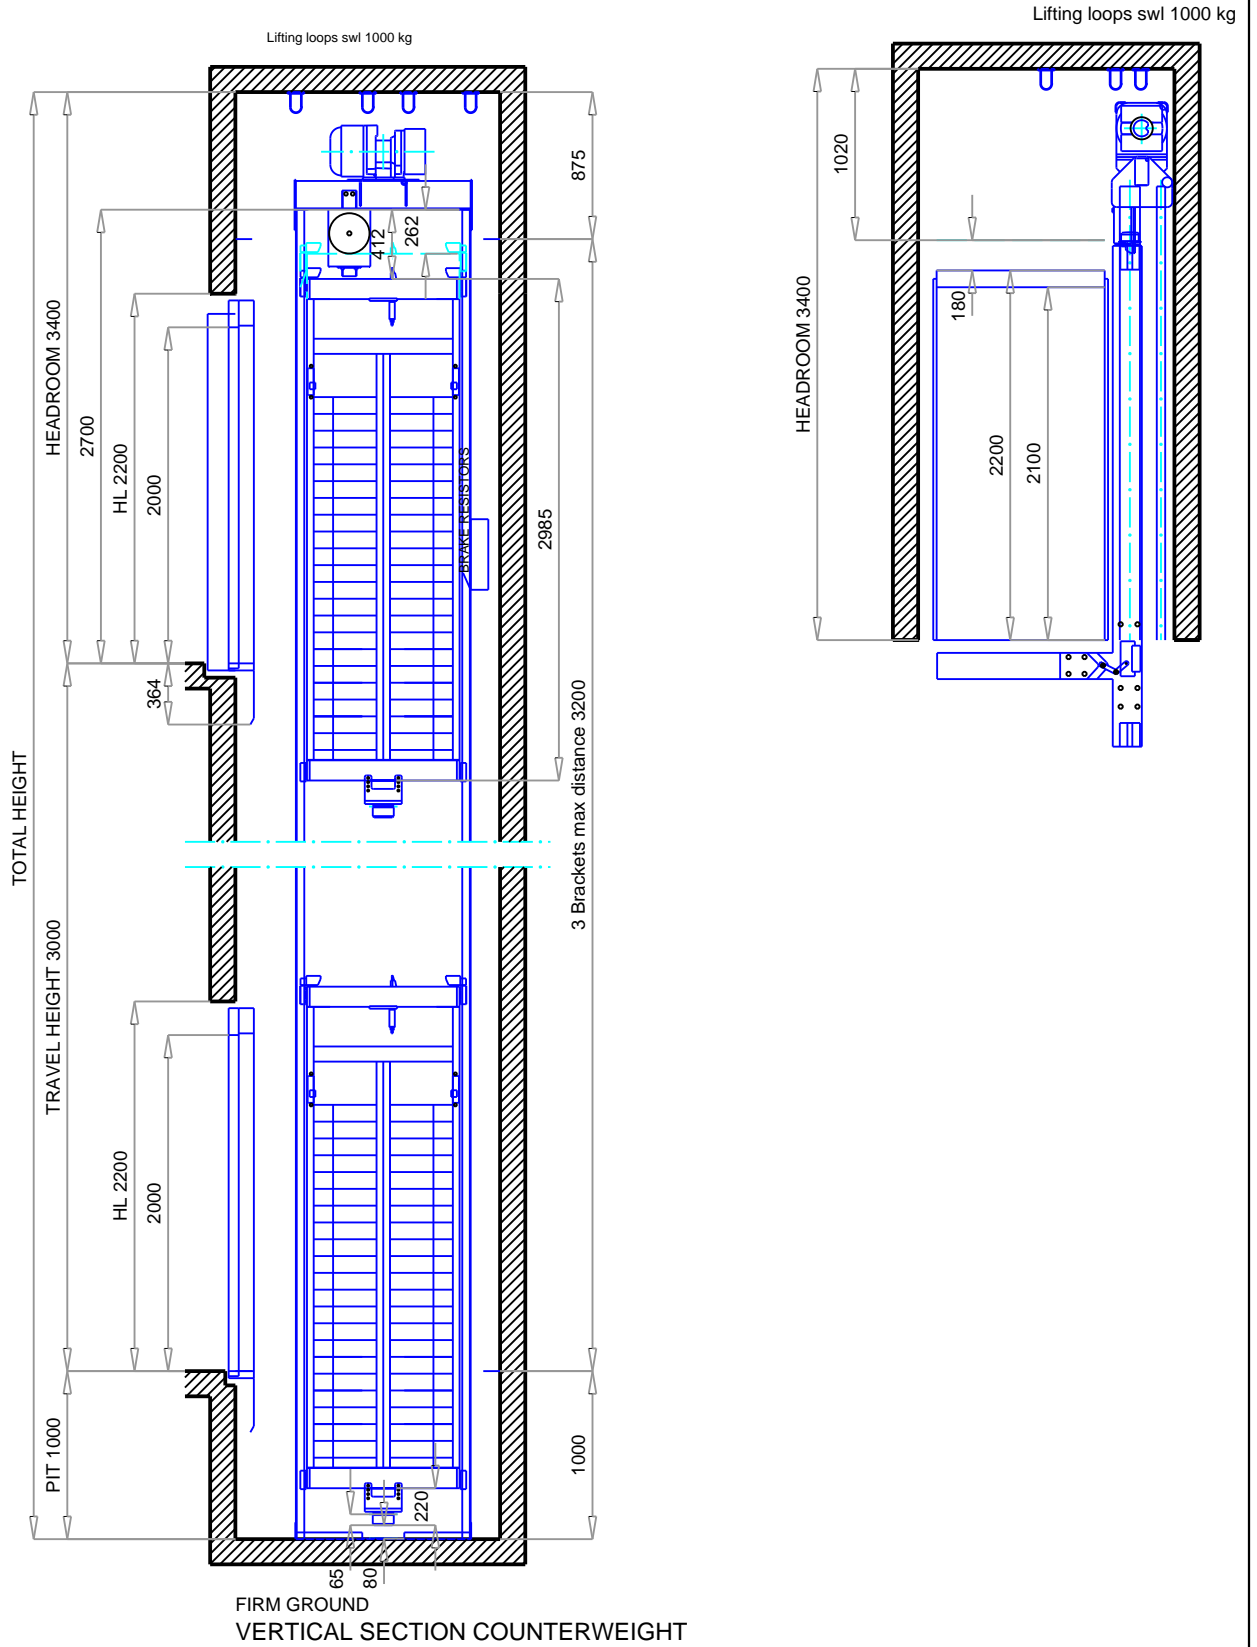


CUSTOMER ----
 ADDRESS Honlaphoz adat
 CITY Magyarország



Orona	DRAWN	20/05/2019 EXNY100004	SCALE	DRAWING N°
	CHECKED		UNIT mm	PAGE 5/9

REF. 857699

DRAFT DRAWING (NOT DEFINITIVE)

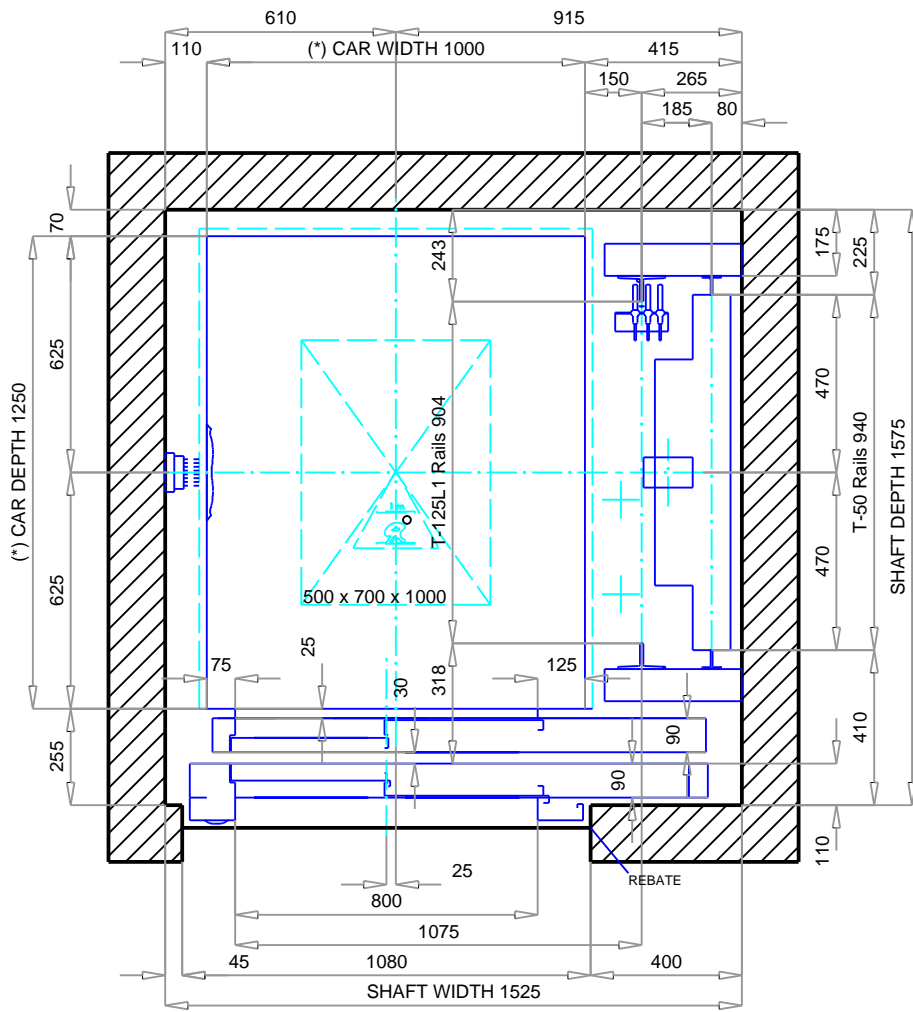

Doors on level

SHAFT PLAN

Scale 1:20


Headroom requirement for a solution compliant

with EN81-20/50 with:

Max Shaft With = 1812 mm

Max Shaft Depth = 1908 mm

Doors on level 1

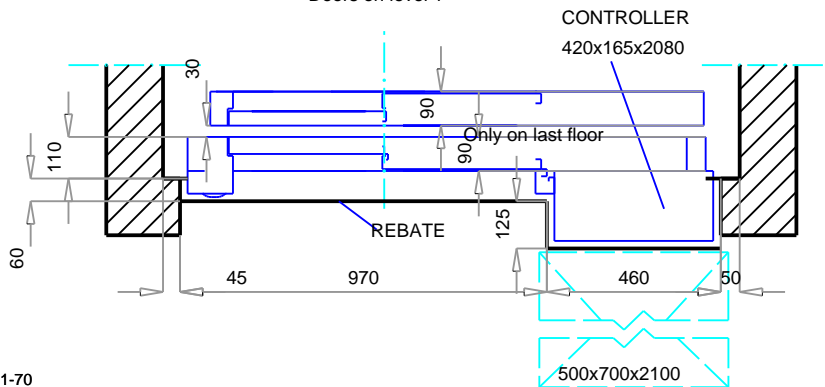

(*) Car dimensions according to EN81-70


CUSTOMER ----
 ADDRESS Honlaphoz adat
 CITY Magyarország



Orona	DRAWN	20/05/2019 EXNY100004	SCALE	DRAWING N°
	CHECKED		UNIT mm	PAGE 6/9

REF. 857699

DRAFT DRAWING (NOT DEFINITIVE)

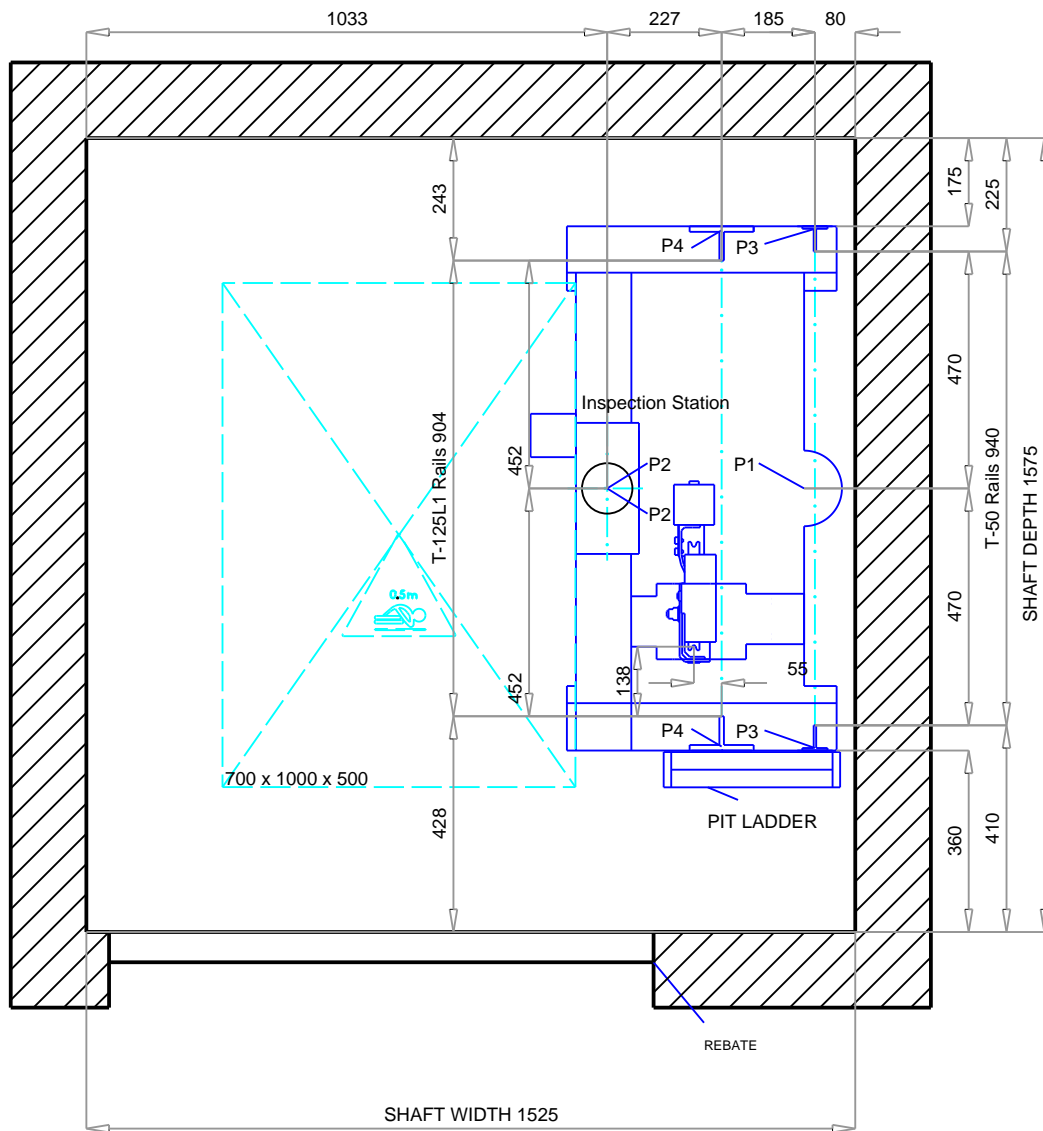

PLAN ON PIT

Scale 1:15

CUSTOMER ----
 ADDRESS Honlaphoz adat
 CITY Magyarország



DRAWN 20/05/2019
 EXNYI00004

SCALE

DRAWING N°


CHECKED

UNIT mm

PAGE 7/9

REF. 857699

DRAFT DRAWING (NOT DEFINITIVE)

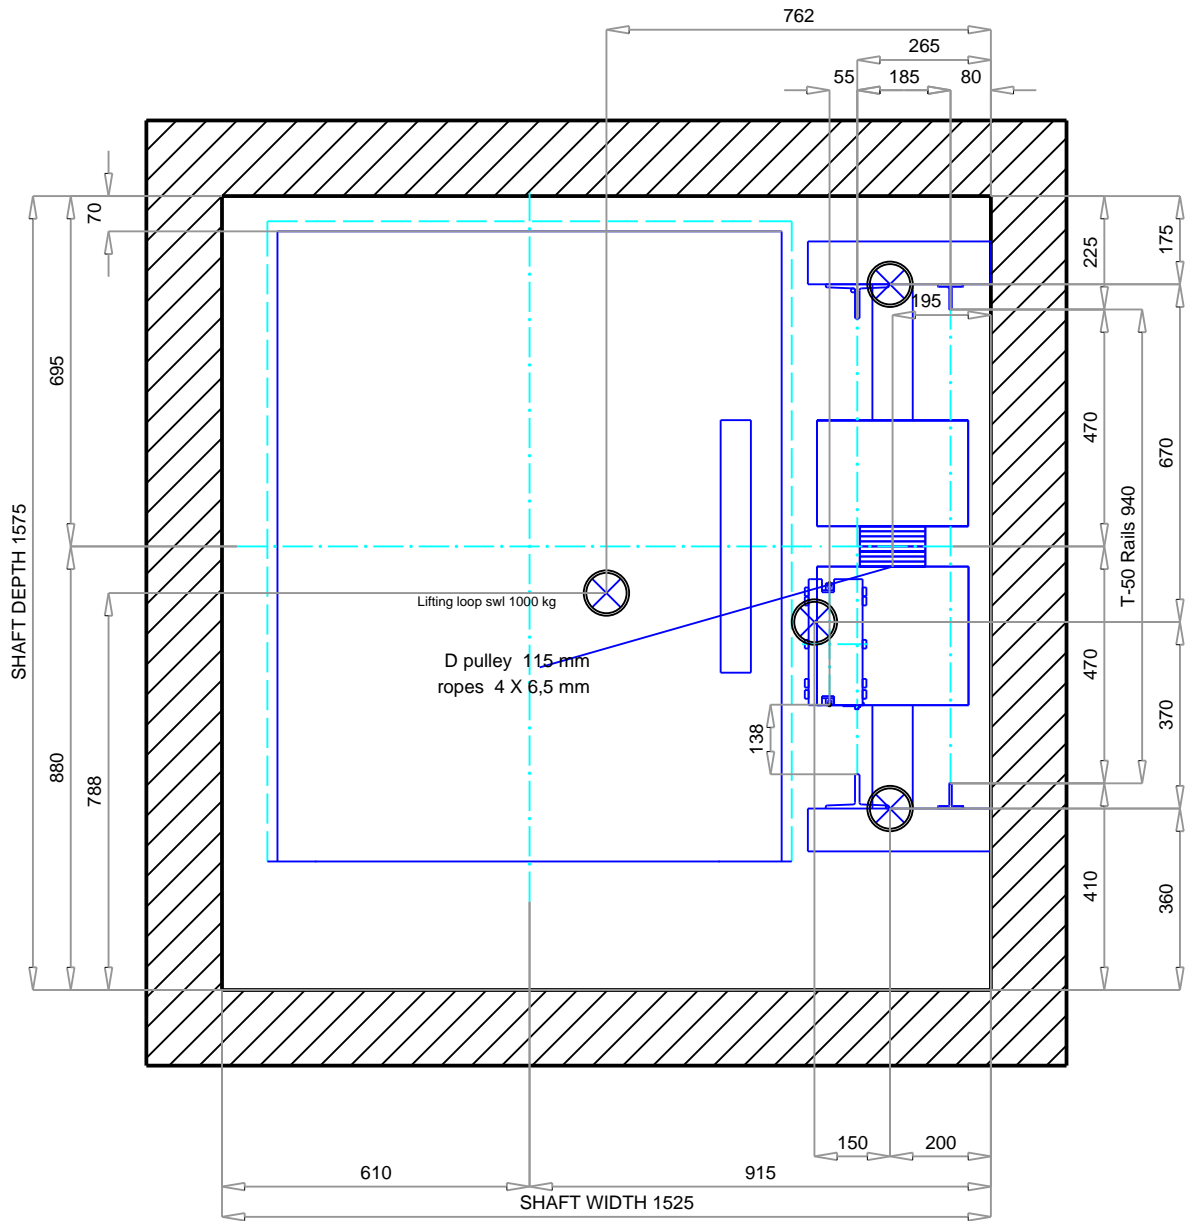

1 LOOP SUPPLIED & TESTED BY ORONA, REMAINING LOOPS BY OTHERS
 MACHINE VIEW
 Scale 1:15


CUSTOMER ----
 ADDRESS Honlaphoz adat
 CITY Magyarország




	DRAWN	20/05/2019 EXNYI00004	SCALE	DRAWING N°
	CHECKED		UNIT mm	PAGE 8/9

REF. 857699

DRAFT DRAWING (NOT DEFINITIVE)

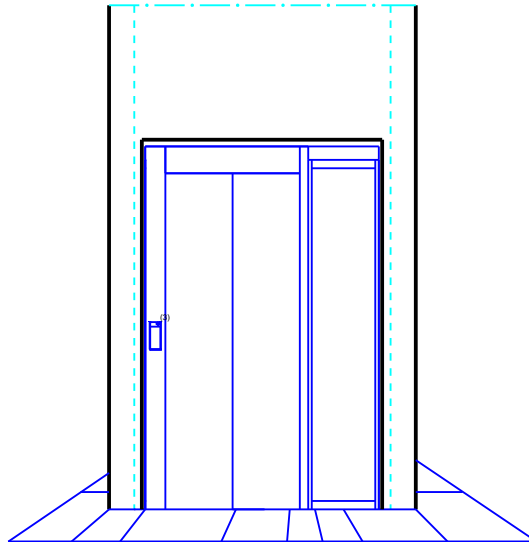

Doors on level 1

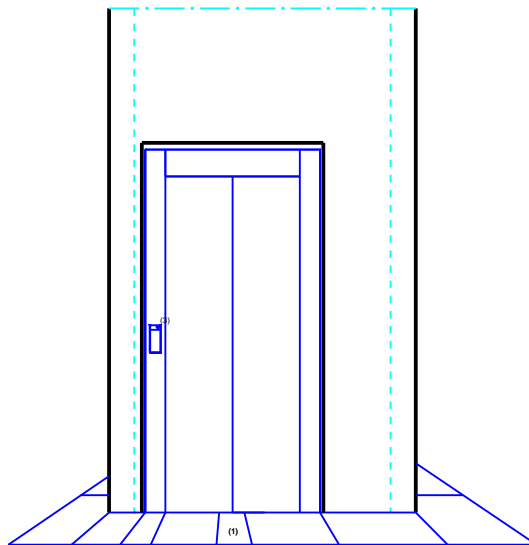


Doors on level 0

- (1) Indicator
- (3) LOP

CUSTOMER ----
ADDRESS Honlaphoz adat
CITY Magyarország



	DRAWN 20/05/2019 EXNYI00004	SCALE	DRAWING N°
	CHECKED	UNIT mm	PAGE 9/9

REF. 857699